


**PROFILE VIEW**

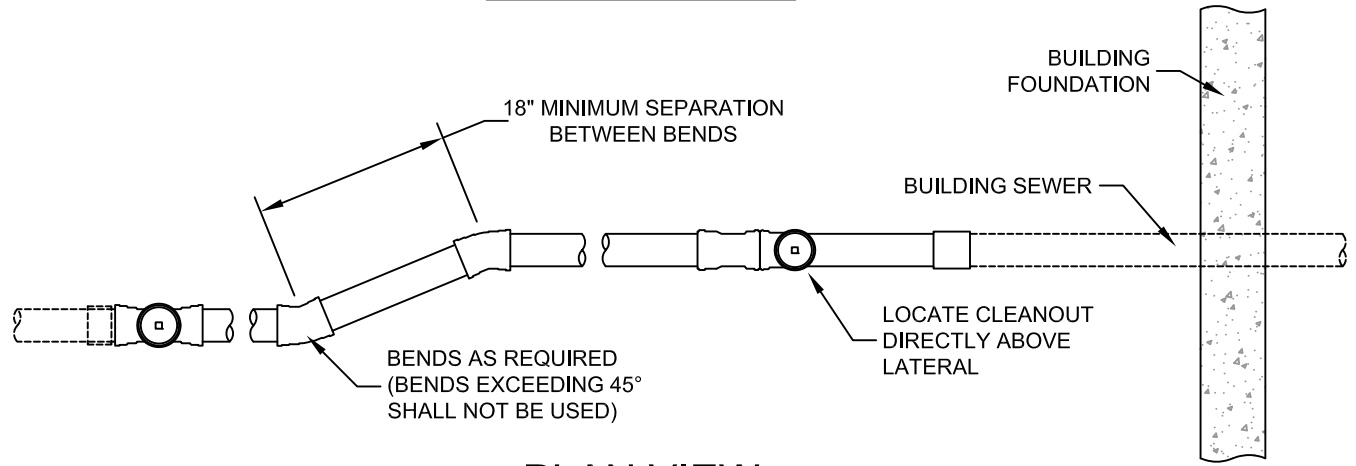

**PLAN VIEW**

**NOTES:**

1. CLEANOUTS ARE REQUIRED ON PRIVATE LATERALS AT THE FOLLOWING LOCATIONS:
  - A: WITHIN 5 FEET OF THE BUILDING FOUNDATION
  - B: AT NO MORE THAN 100 FEET APART, MEASURED FROM THE UPSTREAM ENTRANCE OF THE CLEANOUT
  - C: AT 40 FOOT SPACING WHEN MORE THAN 1 CHANGE OF DIRECTION OCCURS IN A RUN OF PIPE
2. BENDS EXCEEDING 45° SHALL NOT BE USED



**Snyder Basin Water  
Reclamation District**

**GRAVITY LATERAL STUB TO  
GRAVITY BUILDING CONNECTION**

**STANDARD DETAIL  
LAT-05**

Revision Date: 2/22/16