


NOTES:

1. PIPE AND FITTINGS FOR DROP SHALL BE ASTM 3034 SDR 35 PVC WITH GASKETED JOINTS.
2. SEE STANDARD DETAIL NO. MH-01 FOR ADDITIONAL REQUIREMENTS AND SPECIFICATIONS.

ANCHOR STRAP
DETAIL

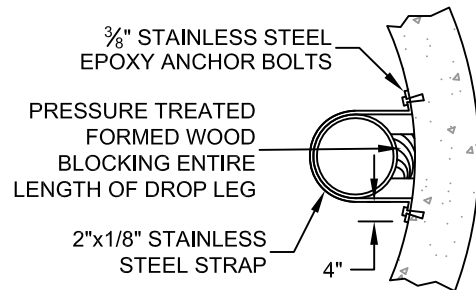

**Snyderville Basin Water
Reclamation District**

INSIDE DROP MANHOLE

STANDARD DETAIL

MH-03

Revision Date: 2/22/16