


PROFILE

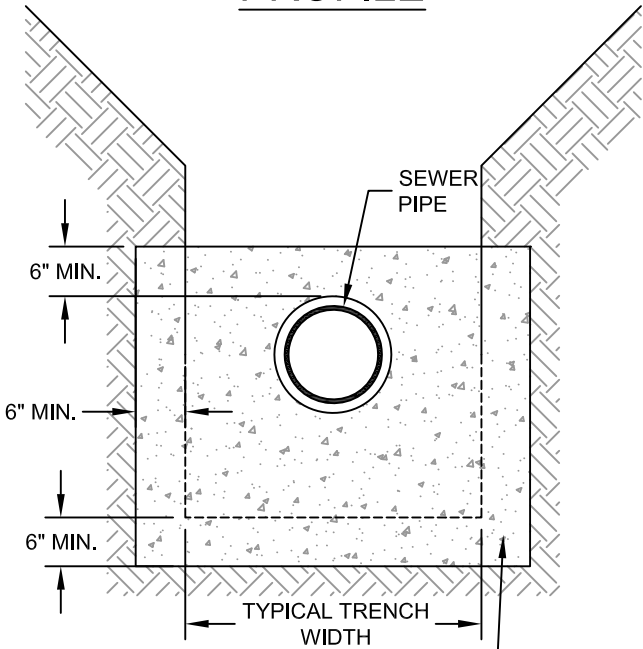

CONCRETE ANCHOR (POURED IN PLACE)
KEY ANCHOR A MINIMUM OF 6" INTO
TRENCH WALLS AND BOTTOM.

SECTION

- NOTES:
1. INSTALL PIPE ANCHORS ON ALL PIPE WITH SLOPES GREATER THAN 33%.
 2. PIPE ANCHORS SHALL BE PLACED AT ALTERNATING BUTT-FUSED JOINTS (80' OR 100' SPACING).